

# City of Akron, Ohio Water Pollution Control Station



*"People dedicated to protecting the environment, for this and future generations, through innovative and cost effective means."*



**Donald L. Plusquellic**  
Mayor

**Richard A. Merolla, Director**  
Department of Public Service

**Michael L. McGlinchy, Manager**  
Public Utilities Bureau


**Brian M. Gresser, Administrator**  
Water Pollution Control Division

City of Akron  
Water Pollution Control Station  
2460 Akron-Peninsula Road  
Akron, Ohio 44313  
Phone (330) 928-1164  
Fax (330) 928-2285

Visit us on the web at:

[www.ci.akron.oh.us/PubUtil/wpc/index.htm](http://www.ci.akron.oh.us/PubUtil/wpc/index.htm)

AKRON WATER POLLUTION CONTROL STATION  
Process Flow Diagram

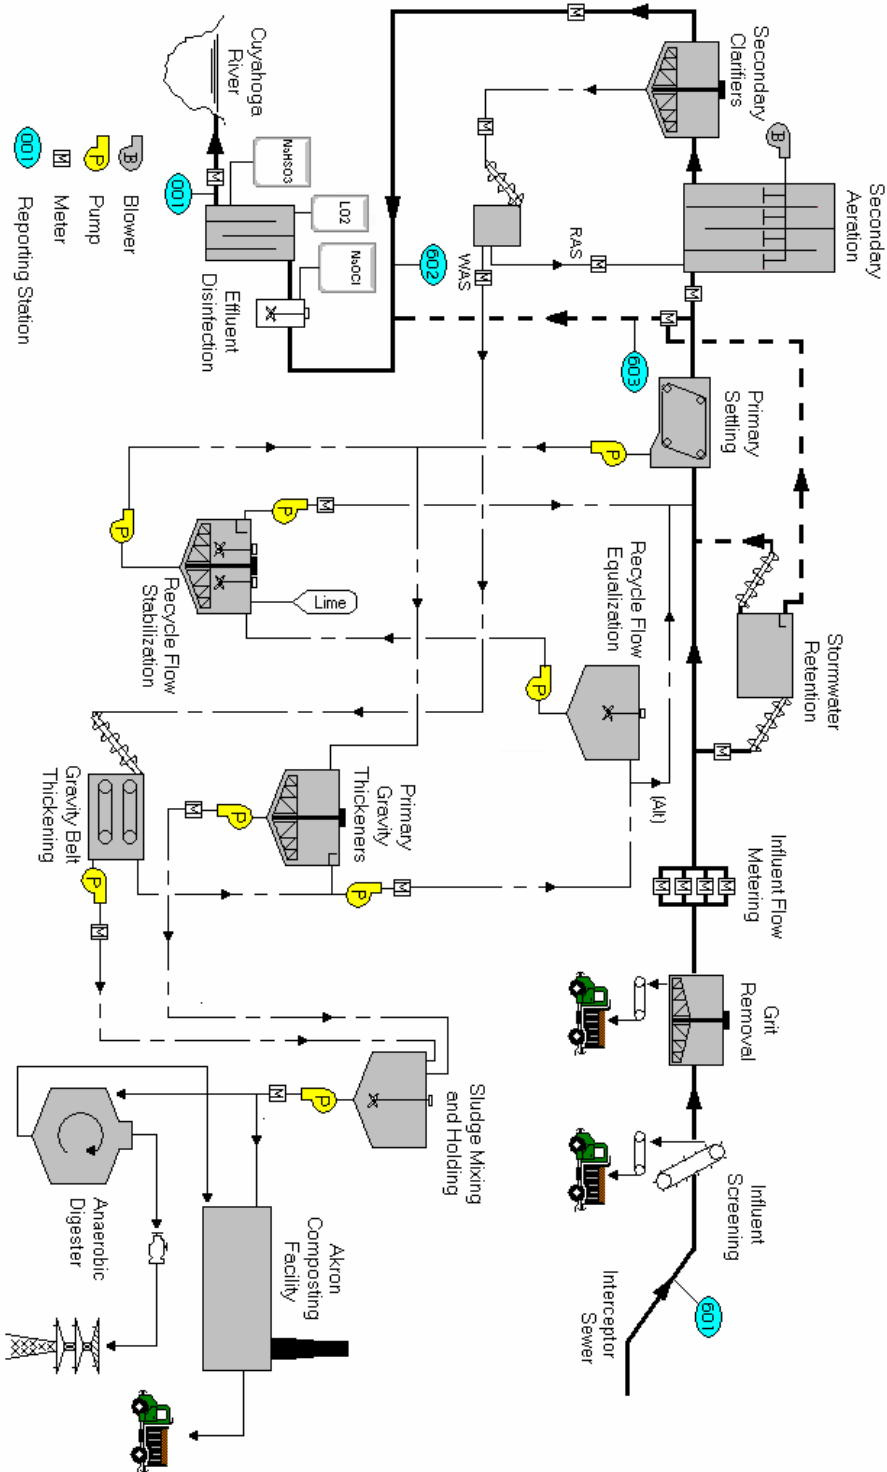

## **INTRODUCTION**

Technology gives us the capability to treat wastewater so that the processed water can be safely returned to the environment. The City of Akron Water Pollution Control Station utilizes proven treatment processes such as the Activated Sludge process. The existing plant has been in continuous service since 1928. There have been, and continue to be, numerous expansions and improvements to the Akron facilities to keep up with changing environmental conditions and restrictions.

## **POPULATION SERVED**

The City of Akron treats its own wastewater and that of several neighboring communities. The total area served is about 96 square miles with an estimated population of 330,000. Neighboring communities served include Cuyahoga Falls, Stow, Springfield, Mogadore, Lakemore, Tallmadge, Fairlawn, Bath, Montrose and some unincorporated areas in the county.

The daily average flow to the plant in 2007 was 78.97 MGD, with peaks (rain, snow/thaw) reaching 266 MGD. Part of the collection system has combined sewers, which means sanitary wastewater and storm water is carried to the treatment plant through the same pipes. Presently the Akron WPCS is considered to have a firm Preliminary treatment capacity of 210 MGD, a Primary treatment capacity of 150 MGD, and a Secondary treatment capacity of 110 MGD.

## **PRELIMINARY TREATMENT**

### **INFLUENT SCREENING**

There are 4 continuously cleaned screens, which are rotated in and out of service to distribute wear evenly among the units. These influent screens remove material such as rags, leaves, sticks, etc., that would clog pumps and pipelines. This material is disposed of by landfilling.

### **GRIT REMOVAL**

The grit removal tanks remove sand and other grit-like materials that would cause wear to pumps and clog pipelines. Four quick settling tanks are designed to remove the grit, but not the light organic solids. The grit is disposed of by landfilling.

### **STORM RETENTION**

The function of the Storm Retention Tanks is to provide flow equalization through temporary storage of wastewater during periods of high flow. When high flows subside, wastewater is pumped out of the basins and into the Pre-Aeration Tanks.

## **PRIMARY TREATMENT**

### **SEDIMENTATION AND FLOATATION**

Primary treatment removes organic solids by sedimentation and flotation. The solids that settle to the bottom of the 24 Primary settling tanks are collected and pumped to the Gravity Thickener Tanks. The treated primary effluent goes on to the Activated Sludge Process for further treatment. Grease and other light matter are removed from the surface of the tanks and dewatered for disposal.

## **SECONDARY TREATMENT**

### **SECONDARY AERATION (Activated Sludge)**

The Activated Sludge Process is an aerobic, suspended growth, biological treatment method. It uses the metabolic reactions of microorganisms to produce a high quality effluent by converting and removing substances that have an oxygen demand. To sustain the aerobic bacteria, approximately 40 million cubic feet per day of air (oxygen) is required.

### **SECONDARY CLARIFIERS**

After a period of approximately 4.5 hours in the aeration tanks, the wastewater flows into Secondary Clarifiers. The solids are separated from the treated wastewater by gravity settling. The treated wastewater leaves the clarifiers and then flows to the Chlorine Contact Tanks. The solids (microorganisms) that settle to the bottom

of the clarifiers are mostly returned to the Aeration Tanks to feed on the incoming organic waste. That which is not returned is sent to the Gravity Belt Thickeners for volume reduction prior to further treatment.

### **EFFLUENT DISINFECTION**

Before the water is released to the Cuyahoga River, it is disinfected with Sodium Hypochlorite (a strong bleach) to kill pathogenic organisms. Approximately 30 minutes of contact time is allotted for the disinfecting process to take place. To reduce the chlorine residual of the treated effluent, Sodium Bisulfite is fed prior to the plant discharge point.

### **EFFLUENT OXYGEN**

An Oxygen enhancement system is utilized at the plant effluent area. Its purpose is to ensure that the dissolved oxygen of the plant effluent is no less than 5.0 mg/L which is mandated by the Ohio EPA. Liquid Oxygen is vaporized and released during periods of possible low Dissolved Oxygen events such as high flow events.

## **SOLIDS HANDLING AND DISPOSAL**

### **RECYCLE FLOW STABILIZATION**

The Recycle Flow Stabilization facility takes flow from other operating units throughout the plant including overflow from the Primary Gravity Thickeners, Gravity Belt Thickeners, Beltfilter pressate from the Compost Facility. These flows are high in suspended solids and phosphates. Treatment consists of lime addition followed by gravity settling and clarification. Settled solids are pumped to the Primary Gravity Thickeners while overflows are pumped to the Pre-Aeration influent.

### **PRIMARY GRAVITY THICKENERS**

Solids removed from the Primary Settling Tanks are pumped to the Primary Gravity Thickeners, where they are thickened by gravity settling. The thickened solids are then pumped to the Mixing and Holding Tanks.

### **GRAVITY BELT THICKENING**

Waste activated solids from the Activated Sludge Process flow to the Gravity Belt Thickeners. Gravity belt thickening concentrates chemically conditioned solids through the gravity separation of water and solids on a continuously moving porous horizontal belt. Thickened solids are then pumped to the Mixing and Holding Tanks.

### **MIXING and HOLDING TANKS**

Thickened Primary and Waste Activated solids are pumped to the Mixing and Holding Tanks and blended together and stored for further processing. There are a total of six tanks, each with a one million gallon capacity.

### **AKRON COMPOST FACILITY**

The blended thickened sludges are pumped under the Cuyahoga River to the City of Akron Composting Facility. The composting process at the Akron Composting Facility is based upon an agitated in-vessel system utilizing four 720ft. long rectangular reactor vessels. The sludge is dewatered using Belt Filter Presses then mixed with bulking agents such as yard waste, hard wood bark, and sawdust. Air is blown into the mixture to provide oxygen for the biological decomposition process. Odors are contained and controlled with 12 two-stage packed tower scrubbers.

### **SUPPORT SERVICES**

There are dozens of support activities performed daily to ensure the wastewater treatment processes operate correctly and efficiently. For example, a complete laboratory is staffed with chemists and technicians who conduct continuous tests as a quality control measure.

A computerized Distributive Control System (DCS) aids in control and optimization of each step of treatment. Maintenance and repair of the complete process is carried out routinely by teams of mechanics and utilityworkers.